



Slide 1

CIAT – Module 2
Sound insulation criteria for new housing




robustdetails®

Welcome to Module 2 – Sound insulation criteria for new housing

Additional notes:


<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>

Slide 2

Module 2 Contents 

This module will cover the following topics:

- Decibels (dB) and sound insulation criteria
- Regulations across UK for airborne sound insulation in attached housing
- Regulations across UK for impact sound transmission in flats/apartments
- The difference between field (on-site) testing and laboratory testing



This Module will cover the following topics

You may notice repetition through this short course, this is to help embed the key information.


Let's move onto our first topic.

Additional notes:

<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>



Slide 3

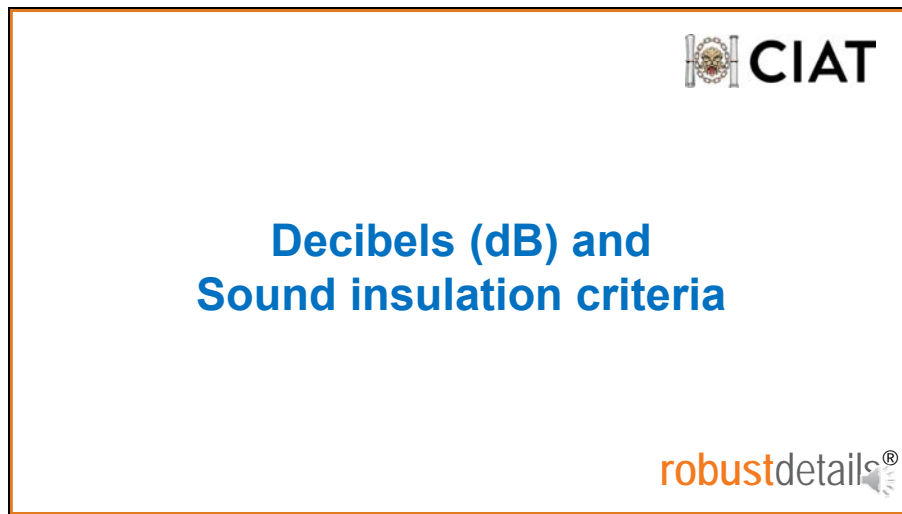

The slide content is enclosed in a rectangular frame with an orange border. In the top right corner, there is a logo for CIAT, which includes a circular emblem with a crown and the letters 'CIAT' in a bold, black, sans-serif font. In the center of the slide, the title 'Decibels (dB) and Sound insulation criteria' is written in a bold, blue, sans-serif font. In the bottom right corner, the 'robustdetails®' logo is displayed in orange and black.


Read slide

Additional notes:

A rectangular box with a black border containing ten horizontal lines for writing notes.

Slide 4

Sound Insulation Criteria




Sound insulation criteria is divided into two main areas:

- **Airborne Sound Insulation**
- **Impact Sound Transmission**

For airborne sound insulation the **higher** the value the **better** the sound insulation

For impact sound transmission the **lower** the value the **better** the sound insulation

Sound insulation is measured in decibels (dB). The frequency range is 100Hz to 3,150Hz and is measured at third octave bands.




Read slide

Additional notes:


<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>

Sound Insulation Testing Equipment




Sound insulation test equipment can include the following:

Airborne Sound Insulation



Specialist loud speakers are commonly used for airborne sound insulation tests, to generate source noise levels (L1) (100-120dB) and also sudden impulse noise for reverberation time (T2) noise decays.

Impact Sound Transmission



Impact tapping machines commonly used for impact sound transmission tests, to generate impact noise by tapping directly on the floor surface using 5 rotating impact hammers.


robustdetails®

Read slide

Additional notes:

Slide 6

Measuring Airborne Sound Insulation (walls & floors)




STEP 1: A loudspeaker is switched on in the source room of house A.

STEP 2: The sound pressure level (L1) is measured by microphones in the source room (house A) known as the source level.

STEP 3: The sound pressure level (L2) is measured by microphones in the adjacent receiving room (house B). Sound transmitted from (A).

STEP 4: As the material fabrics or room finishes can affect the amount of sound absorbed (or reflected) in the receiving room, the reverberation time (T2), or echo time (seconds), is measured.

STEP 5: Calculating the airborne sound insulation (known as the standardised level difference), uses all of the above data.

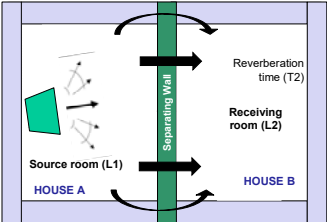
$$D_{nT} = L_1 - L_2 + 10 \log (T_2/0.5)$$

robustdetails®


Read slide

Also note on the diagram the direct and indirect (flanking) transmission pathways shown by the black arrows.

Additional notes:


Slide 7

Measuring Airborne Sound Insulation (walls & floors)



The '**Difference (D)**' = (L1-L2) is the sound insulation the wall or floor is providing. This is then adjusted for the reverberation time T2. These measurements are undertaken across frequencies (100Hz to 3150Hz) and inserted into the equation for **D_{nT}**.

This provides the **standardised airborne level difference** (*normalised [n] to the receiving room reverberation time [T2]*).

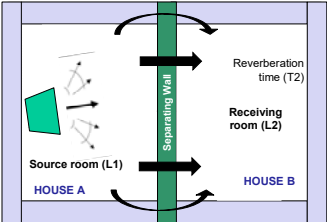

$$D_{nT} = L_1 - L_2 + 10 \log (T_2/0.5)$$

robustdetails®


Read slide

Also note on the diagram the direct and indirect (flanking) transmission pathways shown by the black arrows.

Additional notes:

Slide 8


Weighted - Airborne Sound Insulation (walls & floors)



The actual airborne sound insulation across all of the frequencies (100Hz to 3150Hz) is then converted into one single value **DnT,w** (the weighted airborne sound insulation difference)

Weighting (w) is calculated by comparing the measured results with an international standard reference curve.

The reference curve is adjusted so the total difference between the measured results and the reference curve should be max 32dB (combined across all frequencies). The DnT,w value is then given by **where the reference curve meets the Y-axis at 500Hz.**

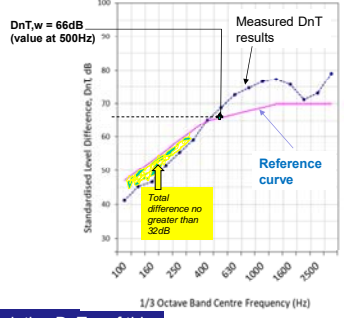

The airborne sound insulation DnT,w of this example separating floor would be 66dB

robustdetails®


Read slide

The graph shows – the measured results for each third octave band frequency
 The reference curve is shown in purple
 The yellow zone shows how the reference curve has been moved, so the total difference between the two graphs (the yellow zone) is no greater than 32dB.
 The sound insulation performance value is then taken from where the ISO reference curve crosses the Y-axis at 500Hz.
 In this case the airborne sound insulation of the separating wall was found to be 66dB (DnT,w).

Additional notes:

Slide 9

Measuring Impact Sound Transmission (floors)




STEP 1: A tapping machine is placed on the upper apartment floor (Flat X) and is switched on to provide a standardised impact sound source.


STEP 2: The impact sound pressure level (L₂) is measured by microphones in (Flat Y) below the test separating floor (receiving room).

STEP 3: As the material fabrics or room finishes can affect the amount of sound absorbed (or reflected) in the receiving room, the reverberation time (T₂), or echo time (seconds), is measured.

STEP 4: Calculating the impact sound level uses all of the above data.

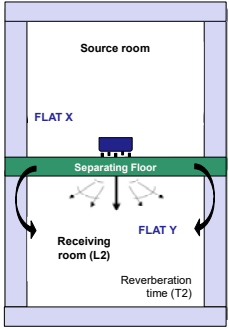

$$L_{nT} = L_2 - 10 \log (T_2/0.5)$$




Read slide

Note how the impact tapping machine drives vibration energy directly into the separating floor and the supporting walls, which then radiates sound into the apartment room below.

Additional notes:

Slide 11


Weighted – Impact Sound Transmission (floors)



The actual impact sound transmission across all of the frequencies (100Hz to 3150Hz) is then converted into one single value **L'nT,w** (the weighted impact sound transmission)

Similar to airborne sound insulation **Weighting (w)** is calculated by comparing the measured results curve with an international standard reference curve.

The **reference curve** is adjusted so the **total difference** between the measured results and the reference curve should be max 32dB (combined across all frequencies). The **L'nT,w** value is then given by where the reference curve meets the Y-axis at 500Hz.

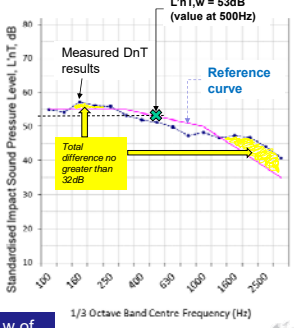

The impact sound transmission L'nT,w of this example separating floor would be 53dB


robustdetails®

Read slide

Additional notes:

Slide 12

Spectrum Adaptation Terms




Spectrum adaptation terms are used by some countries, where the building regulations and performance standards wish to emphasise specific frequency bands. This is often to take into account (or correct) for various types of noise sources. **There are several commonly used spectrum adaptation terms:**

For airborne sound insulation
 C – living noise
 C_{tr} – low frequency emphasis

For impact sound transmission
 C_i – low frequency emphasis

NOTE: England, Wales & N.Ireland
 utilise C_{tr} for airborne sound insulation measurements

Standard ISO reporting format $D_{nT,w} = XdB (C; C_{tr})$
Example: $D_{nT,w} = 66dB (-2; -7)$
 Calculated as:
 • $D_{nT,w+C} = 64dB$
 • $D_{nT,w+C_{tr}} = 59dB$



Read slide

The international standard ISO reporting format is $D_{nT,w} = XdB (C; C_{tr})$ [in brackets]

So lets take an **Example: where $D_{nT,w} = 66dB$ followed by (-2; -7) [in brackets]**

When calculated this would give the following as:

- $D_{nT,w+C} = [66dB \text{ minus } C \text{ correction which is } -2] = 64dB$
- $D_{nT,w+C_{tr}} = [66dB \text{ minus } C_{tr} \text{ correction which is } -7dB] = 59dB$

Additional notes:



Regulations across UK
for **airborne sound insulation** in attached
housing




So why is sound insulation important and why reduce sound transmission between attached houses and flats?

Additional notes:

<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>

Slide 14

UK – airborne sound insulation standards



- Airborne sound insulation standards for separating walls and floors are often a **minimum performance level**.
- **England, Wales and Northern Ireland** use the same criteria $D_{nT,w}+C_{tr}$ and same levels of a minimum performance standard.
- **Scotland** use $D_{nT,w}$

Airborne sound insulation	England	Wales	N.Ireland	Scotland
	Part E	Part E	Part G	Section 5
	Min (dB)	Min (dB)	Min (dB)	Min (dB)
<i>Criteria</i>	$D_{nT,w}+C_{tr}$	$D_{nT,w}+C_{tr}$	$D_{nT,w}+C_{tr}$	$D_{nT,w}$
Separating Walls	45	45	45	56
Separating Floors	45	45	45	56

robustdetails®

Read slide

The table shows the airborne sound insulation building standards across the four UK nations

Note that Scotland does not include a low frequency correction C_{tr} and thus uses a **different airborne sound insulation criteria** to England, Wales and Northern Ireland.

When assessing constructions tested in other parts of the UK or overseas with different performance standards to your national standards, please seek expert acoustic advice to ensure the construction adopted will meet your local national sound insulation standards.

Additional notes:



Regulations across UK
for **impact sound transmission** in flats /
apartments



So why is sound insulation important and why reduce sound transmission between attached houses and flats?


Additional notes:

<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>




Slide 16

UK – impact sound transmission standards



- Impact sound transmission standards are often a **maximum performance level**.
- **England, Wales, Scotland and N.Ireland** use the same criteria $L'_{nT,w}$.

Impact sound transmission	England	Wales	N.Ireland	Scotland
	Part E	Part E	Part G	Section 5
	Max (dB)	Max (dB)	Max (dB)	Max (dB)
Criteria	$L'_{nT,w}$	$L'_{nT,w}$	$L'_{nT,w}$	$L'_{nT,w}$
Separating Floors	62	62	62	56


robustdetails® 

Read slide


Note the lower impact target impact transmission performance for Scotland which is a higher performance standard, as the lower the value for impact the better the performance.

Additional notes:

Slide 17



The difference between on site (field)
performance and laboratory performance for
separating walls and floors




Read slide

Additional notes:

<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>


Slide 18

On Site Testing versus Laboratory Testing




- **On site testing** of separating walls and floors includes **all sound transmission pathways** direct and flanking.
- **Laboratory testing** predominantly will only test the **direct transmission**.
- On site performance can be 6dB to 15dB lower than laboratory performance, depending on the full test separating wall or floor structure.
- **Note:** Laboratory testing can be used for assessing sound insulation of individual components (e.g. floating floor treatments (FFTs), resilient bars, downlighters and bonded resilient floor coverings).

On-site (field) testing



Laboratory testing




robustdetails®

Read slide


Note in the diagrams the number of transmission sound pathways for on-site testing versus laboratory testing

Care should be taken at all times when specifying complete separating wall and floor construction details. Seek specialist advice or refer to the RD Handbook to check the specifications available.

Additional notes:



Summary Test – Module 2
Quick Review of Key Points



Now for a quick TEST to recap on Module 2


Additional notes:

<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>




Slide 20

Summary Test – Module 2



No.	Question
1	Complete the phrase - For airborne sound insulation the XXXXXX the value the better the sound insulation?
2	Complete the phrase - For impact sound transmission the XXXXXX the value the better the sound insulation
3	For airborne sound tests - what is commonly used to create the source noise?
4	For impact sound tests - what is commonly used to create the source noise?
5	Why is the reverberation time measured in the receiving rooms?
6	What is D, L1 and L2 in airborne sound insulation tests?
7	For impact sound transmission do we measure the sound pressure difference between two rooms?
8	What is the maximum difference in dB allowed when using the international references curves?
9	Calculate the $D_{nT,w}+C_{tr}$, where the $D_{nT,w}=66dB$ and the $C=-5dB$ and $C_{tr} = -11dB$?
10	What is the minimum airborne sound insulation performance in dB (and criteria) in England for separating walls?
11	A housebuilder has successfully designed and built an apartment block in England. Could they transfer that design to Scotland automatically?
12	A designer has been told by a specifier that the laboratory test of the separating wall met the attached housing building regulations. Should the designer adopt the design specification into their real site?



Here are 12 questions – you may wish to PAUSE the recording and test yourself against these questions.


Once you have answered all of them – the next slide provides the answers. In 10 seconds the slide will change so press pause now if you want to test yourself first.

Thank you for following Module 2.

Additional notes:

Slide 21

Summary Test – Answers	
No.	Answer
1	Higher
2	Lower
3	Specialist loudspeakers
4	Tapping machines
5	To take account of acoustic absorption and reflection in the receiving room
6	D is the level difference, L1 is the source room and L2 is the receiving room sound pressure levels
7	No - only the receiving room sound pressure level
8	32 dB
9	55 dB
10	min 45 dB $D_{nT,w+Ctr}$
11	No. Different criteria are used, specialist acoustic advice should be sought first.
12	No. Laboratory tests of separating wall and floor complete structures do not take into account all transmission pathways. Care should be taken and specialist acoustic advice sought.





Here are the answer to Module 2's quick test.
How did you do?


Thankyou for following Module 2

Additional notes:

<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>



End of CIAT – Module 2
Sound insulation criteria for new housing



This is the end of Module 2 – Sound insulation criteria for new housing

Additional notes:

<hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>

